


THIS REPORT IS PROPOSED
AS AN EVALUATION OF THE
SITE FOR SOILS AND CONDITIONS
FOR A SEPTIC SYSTEM (this is *not* a design)

DEBLAR ENTERPRISES

PO BOX 337 KELSO, WA 98626
866.868.6775 360.273.8898 (FAX)

SOIL AND SITE EVALUATION FORM

Property Address 485 APPLECREEK RD Parcel Number WP2304009
 Sec: 23 Tn: 9N Rg: 4W Tax Lot Number: 0 Subdivision Number: 0 Lot: 5 of 0
 Applicant Name: (Name Subdivision is listed under): DON & ERLEANE JACOBSON

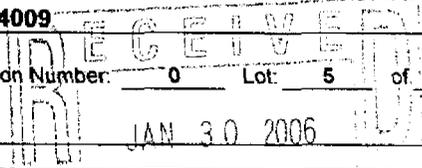

SOIL DATA

Test Hole #1 0 - 32 WELL STRUCTURED
SILT LOAM
32-72 SILT LM w/ SN & GRAVEL
0

Test Hole #3 0 - 37- WELL STRUCTURED
SILT LOAM
37 - 75 SI LM WITH SAND
AND GRAVEL

Test Hole #2 0 - 38 WELL STRUCTURED
SILT LOAM
38 - 77 SILT LOAM
WITH SAND & GRAVEL

Test Hole #4 _____

Soils mapped as: OLYMPIC SILT LOAM ; Soils logged on Date: 25-Jan-06

Soil Mottling Noted at: NONE OBSERVED in. ; WAC Soil Classification: TYPE - 5 Hydraulic Loading: .45G/SF/D gal/sf/day

SITE DATA

Topography: LEVEL Drainage: NONE ASSIGNED

Slopes: NONE %; Slopes in Proposed Drainfield Location: 0 %; Bedrock type & Depth: NONE OBSERVED

Distance to:
 Surface Water: >100' Ft.; Existing Wells: >100' Ft.; Public Sewers: N/A

Other Site Characteristics (structures, outcroppings, embankments, etc.) BUILDING SITE IS LEVEL. EASTERLY PROPERTY LINE
IS CENTERLINE OF APPLE CREEK

DESIGNER STATEMENT: Based on site conditions and soils observed, it is my determination the primary on-site sewage system is approved for a:

Conventional Gravity Flow System:
367 L.F. OF SEPTIC DRAINFIELD. BY
USING INFILTRATORS INSTALLED LENGTH
CAN BE REDUCED BY UP TO 40%

Designed system:
NOT REQUIRED


The primary drainfield will require 1067 sq. ft. (of drainfield) Min.: and 2000 sq. ft. (land area)


The reserve system proposed is: GRAVITY with 1067 sq. ft. (drainfield) and 2000 sq. ft. (land)

SUBMITTED BY: LARRY BURK

DATE: 1/25/2006


CERTIFICATION #: 5100193

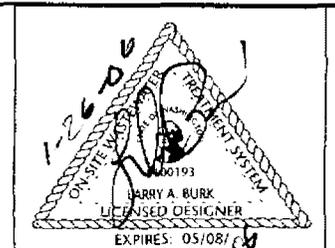

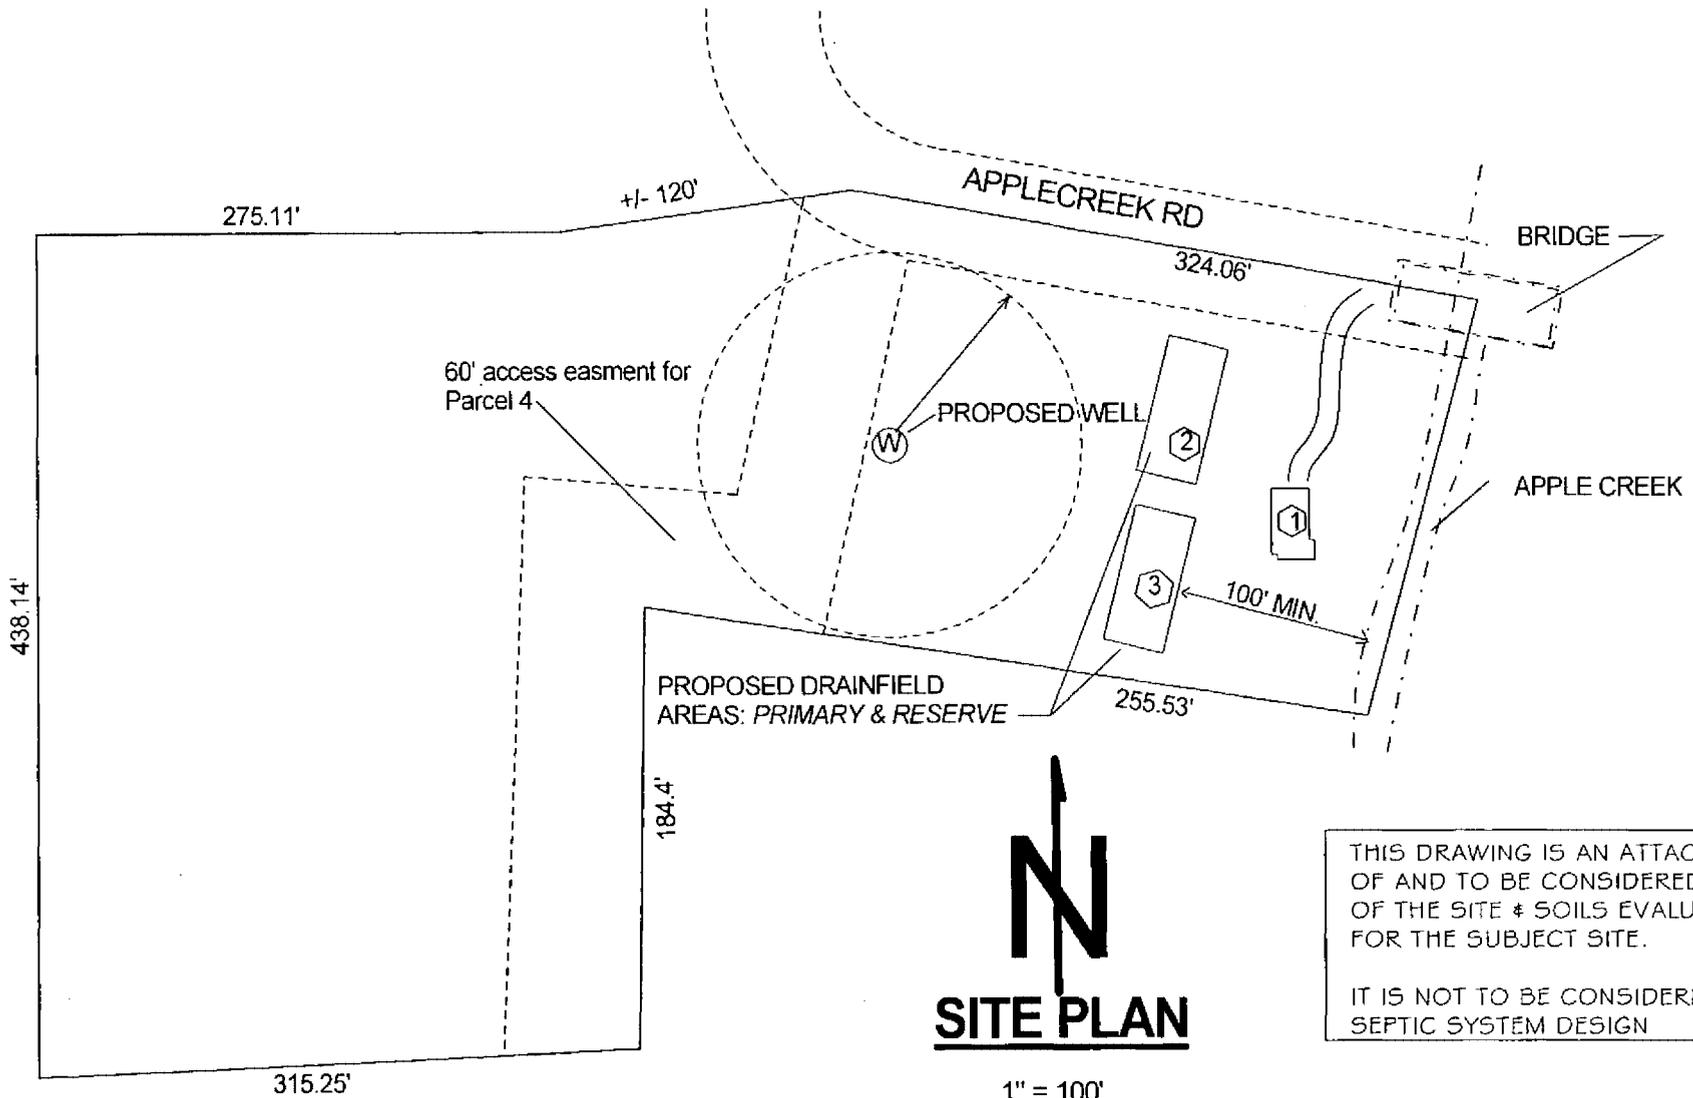

THIS DRAWING IS AN ATTACHMENT OF AND TO BE CONSIDERED A PART OF THE SITE & SOILS EVALUATION FOR THE SUBJECT SITE.

IT IS NOT TO BE CONSIDERED A SEPTIC SYSTEM DESIGN

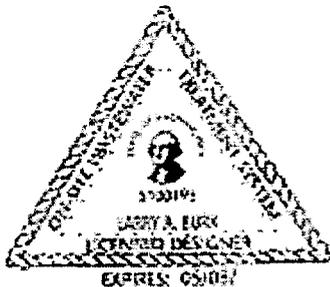

OWNER: DON & ERLEANE JACOBSON
ADDRESS: 485 APPLECREEK RD
TP: WP2304009