WLITZ COUNTY

DEPARTMENT OF COMMUNITY DEVELOPMENT

305 CHURCH STREET
KELSO, WASHINGTON 98626 TEL. NO. 577-3052

SEWAGE PERMIT APPROVAL

Property Address: 375 BAKER RD. Town ARIEL

Permit Name: JOHN S. MILLER

Home Address: 2305 NE 40 24

City PORTLAND State ORE. Zip Cope 97212

Section: 23 Township 6N Range 3E Tax Lot# T 7 B

Subdivision Lot Block

Lot Size Number of Acres 5

APPROVED FOR: 1 BEDROOM CABIN

Septic Tank: 750 Gallon minimum Capacity (two compartment)

Drainfield: 150 Sq. Ft., Total minimum (length X width of trenches)

Suggested layout of system:

Number of drainfield lines: 2

Length of drainfield lines: 25' } OR

Width of distribution lines: 3'

Trench Depth: Minimum 24" Maximum 36"

Minimum distance between Trenches — Center to Center 7.5'

OTHER REQUIREMENTS:

① TRENCH BOTTOMS MUST BE LEVEL AND FOLLOW SLOPE CONTOURS.

② TRENCHES MUST BE 100' MINIMUM FROM WATER.

③ TRENCHES MAY BE LOCATED NO CLOSER THAN 10' FROM TREES.

OTHER COMMENTS OR ITEMS TO BE CONSIDERED:

0-48" sandy clay loam, no mottling

<5% slope

pump needed

APPROVED BY: Gary Crane DATE: 6-21-77
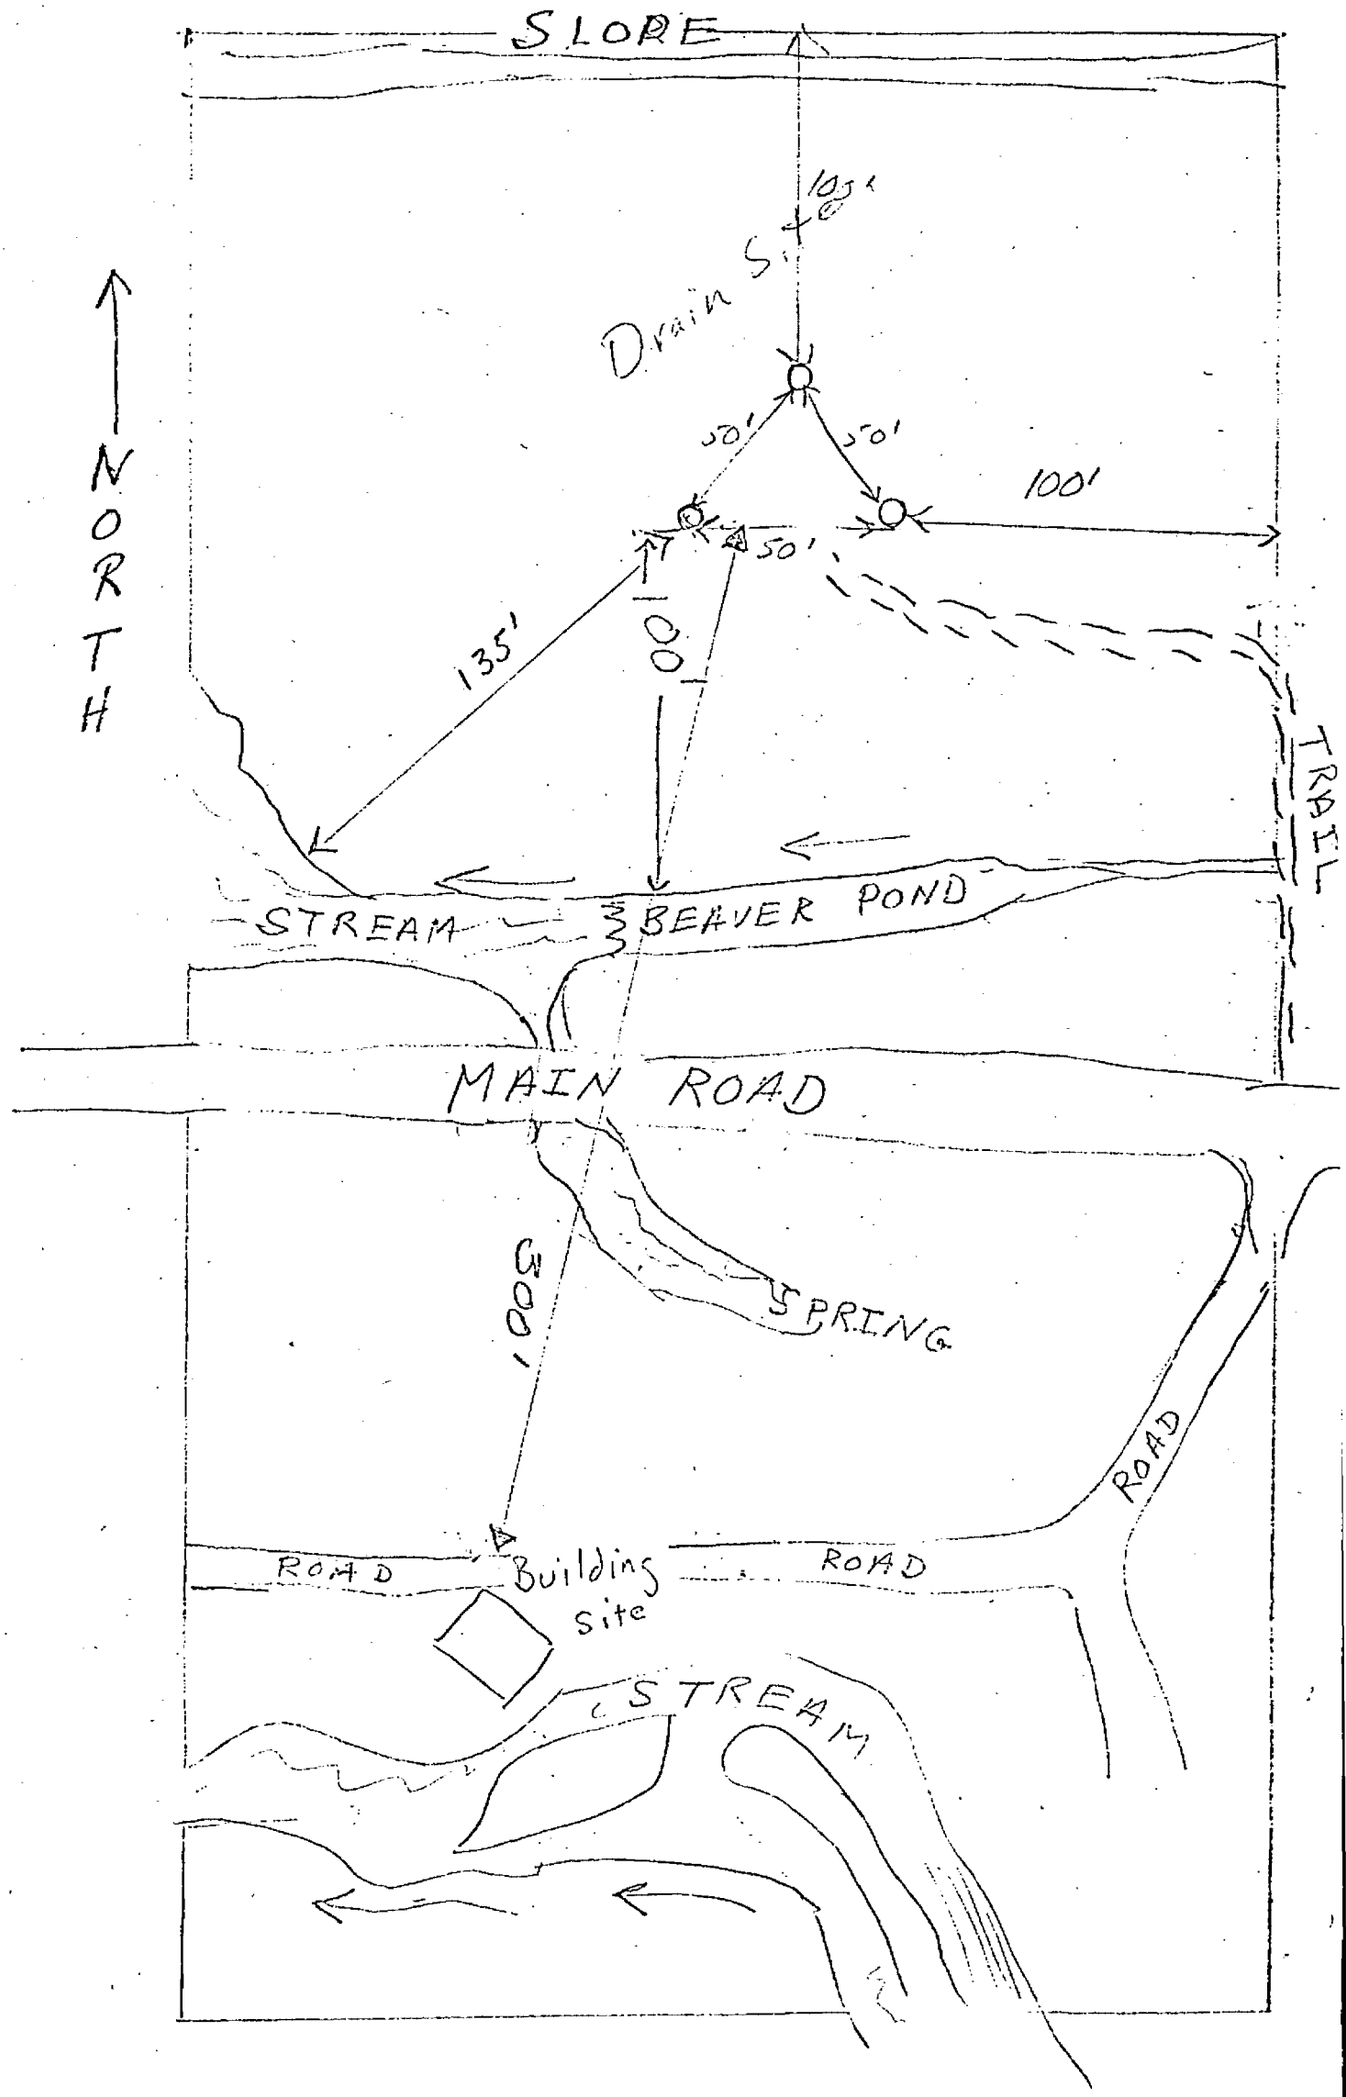
John [illegible] & Suzanne K. [illegible]ler
375 Baker Rd. Ariel Washington