



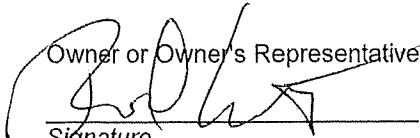
Washington State Patrol  
Fire Protection Bureau  
Phone: (360) 596-3900


This document was prepared by Residential Care Services for the Locator website.

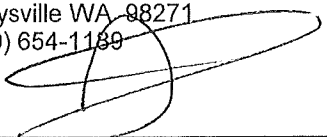
<b>Business Name</b>	Country Meadow Village	<b>Provider Number</b>	001020
<b>Address</b>	1501 COLLINS RD ,	<b>Approval Status</b>	Approved
<b>City, State, Zip</b>	Sedro-Woolley, WA 98284	<b>Facility Type</b>	Residential Care

On 08/31/2018 the Office of the State Fire Marshal conducted an inspection at your facility.

All violations noted during previous related inspection(s) have been corrected.

Owner or Owner's Representative  
  
 \_\_\_\_\_  
 Signature

  
 \_\_\_\_\_  
 Print Name and Title

Deputy State Fire Marshal David Ridley  
 2700 116 ST NE  
 Marysville WA 98271  
 (360) 654-1189  
  
 \_\_\_\_\_  
 Signature

Right of appeal. Any person may appeal any decision made by the Fire Protection Bureau in accordance with WAC 212-12.



Washington State Patrol  
 Fire Protection Bureau  
 Phone: (360) 596-3900

This document was prepared by Residential Care Services for the Locator website.

<b>Business Name</b>	Country Meadow Village	<b>Provider Number</b>	001020
<b>Address</b>	1501 COLLINS RD ,	<b>Approval Status</b>	Disapproved
<b>City, State, Zip</b>	Sedro-Woolley, WA 98284	<b>Facility Type</b>	Residential Care

On 07/03/2018 the Office of the State Fire Marshal conducted an inspection at your facility.

Code Requirement	Statement of Violation
------------------	------------------------

**1 Admin New Requirements**

<p>For your information:</p> <p>I informed the Maintenance Director that from this point forwards, quarterly inspections of the sprinkler system are required.</p> <p>703.2 Opening protectives. Opening protective shall be maintained in an operative condition in accordance with NFPA 80.        NFPA 80 Chapter 19 Installation, Testing, and Maintenance of Fire Dampers.        19.4 Periodic Inspection and Testing.        19.4.1 Each damper shall be tested and inspected 1 year after installation.        19.4.1.1 The test and inspection frequency shall then be every 4 years, except in hospitals, where the frequency shall be every 6 years.</p> <p>EFFECTIVE JULY 1, 2018.        907.10 National Institute for Certification in Engineering Technologies.        907.10.1 Scope. This section shall apply to new and existing fire alarms systems.        907.10.2 Design review. All construction documents shall be reviewed by a NICET III in fire alarms or a licensed professional engineer (PE) in Washington prior to being submitted for permitting. The reviewing professional shall submit a stamped, signed, and dated letter; or a verification method approved by the local authority having jurisdiction indicating the system has been reviewed and meets or exceeds the design requirement of the Washington and the local jurisdiction (effective July 1, 2018).        907.10.3 Testing/maintenance: All inspection, testing maintenance and programing not defined as "electrical trade" by chapter 19.28 RCW shall be completed by a NICET II in fire alarms (effective July 1, 2018).</p>	
---	--



**Washington State Patrol  
Fire Protection Bureau**  
Phone: (360) 596-3900

<b>Business Name</b> Country Meadow Village	<b>Provider Number</b> 001020
<b>Address</b> 1501 COLLINS RD ,	<b>Approval Status</b> Disapproved
<b>City, State, Zip</b> Sedro-Woolley, WA 98284	<b>Facility Type</b> Residential Care

On 07/03/2018 the Office of the State Fire Marshal conducted an inspection at your facility.

Code Requirement	Statement of Violation
------------------	------------------------

**2 Operational Inspection and Testing**

<p>Emergency power systems, including all appurtenant components shall be inspected and tested under load in accordance with NFPA 110 and NFPA 111.</p> <p>Exception: Where the emergency power system is used for standby power or peak load shaving, such use shall be recorded and shall be allowed to be substituted for scheduled testing of the generator set, provided that appropriate records are maintained.</p> <p>(IFC 604.5 2015)</p>	<p>The facility did not provide documentation showing the automatic emergency backup diesel generator had received monthly load tests.</p>
--	--

**3 Commercial Kitchen Hoods - General**

<p>Commercial kitchen exhaust hoods shall comply with the requirements of the International Mechanical Code.</p> <p>(IFC 0609.1)</p>	<p>The kitchen suppression equipment needs to be configured to meet the new cooking appliance.</p>
--	--

**4 Fire Protection Systems - Records**

<p>Records of all system inspections, tests and maintenance required by the referenced standards shall be maintained.</p> <p>(IFC 0901.6.2)</p>	<p>The facility did not provide the four yearly fire/smoke damper report.</p> <p>The facility did not provide the annual back flow test maintenance report.</p> <p>The facility did not provide both biannual kitchen supersession system reports.</p>
---	--

**5 Rooms and Spaces**

<p>In the event of pwer supply failure, and emergenny electrical system shall automatically illunate all of the following areas:</p> <ol style="list-style-type: none"> <li>1. Electrical equipment rooms.</li> <li>2. Fire command centers.</li> <li>3. Fire Pump rooms</li> <li>4. Generator rooms</li> <li>5. Public restrooms with an area greater than 300 square feet.</li> </ol> <p>(IFC 1008.3.3 2015)</p>	<p>There was no emergency lighting in the generator switch room.</p>
--	--

This document was prepared by Residential Care Services for the Locator website.



Washington State Patrol  
 Fire Protection Bureau  
 Phone: (360) 596-3900

This document was prepared by Residential Care Services for the Locator website.

<b>Business Name</b> Country Meadow Village	<b>Provider Number</b> 001020
<b>Address</b> 1501 COLLINS RD ,	<b>Approval Status</b> Disapproved
<b>City, State, Zip</b> Sedro-Woolley, WA 98284	<b>Facility Type</b> Residential Care

On 07/03/2018 the Office of the State Fire Marshal conducted an inspection at your facility.

Code Requirement	Statement of Violation
------------------	------------------------

**6 Fire Drills**

<p>In all Group I, Group E, and Group R2 Occupancies licensed by the state, at least twelve planned and unannounced fire drills shall be held every year. Drills shall be conducted quarterly on each shift in Group I and Group R2, Occupancies and monthly in Group E Occupancies to familiarize personnel with signals and emergency action required under varied conditions. A detailed written record of all fire drills shall be maintained and available for inspection at all times. When drills are conducted between 9:00 p.m. and 6:00 a.m., a coded announcement may be used instead of audible alarms. Fire drills shall include the transmission of a fire alarm signal and simulation of emergency conditions. The fire alarm monitoring company shall be notified prior to the activation of the fire alarm system for drill purposes and again at the conclusion of the transmission and restoration of the fire alarm system to normal mode.</p> <p>(WAC 212-12-044)</p>	<p>The fire drills did not contain a detailed record of the drills.</p>
--	---

**Next inspection scheduled on or after: 08/02/2018**

**Right of appeal.** Any person may appeal any decision made by the Fire Protection Bureau in accordance with WAC 212-12.

Owner or Authorized Representative

  
 Signature

Sandra Jensen Executive Director  
 Print Name and Title

Deputy State Fire Marshal David Ridley  
 2700 116 ST NE  
 Marysville WA 98271  
 (360) 654-1189

  
 Signature