




Rattray Farms

3451 Bethany Rd. Sunnyside, Wa 98944

Phone: (509) 837-7498



Permit # 64-32973

Start pumping June 2001 end Oct 2001

Flow meter reading

68,660	start
114,873	end of season
<hr/>	
46,213	ac/ft total of season

Permit # 64-32978

no ground water pumped



STATE OF WASHINGTON

DEPARTMENT OF ECOLOGY

15 West Yakima Avenue, Suite 200 • Yakima, Washington 98902-3452 • (509) 575-2490

November 16, 2001

Charles Rattray
3451 Bethany Rd
Sunnyside WA 98944

RE: Application No(s). G4-32973, G4-32978

Earlier this year, the Department of Ecology issued an Emergency Drought Authorization under the above-referenced application number for the use of emergency wells in the Yakima River basins to supplement reduced deliveries during this irrigation season. In some cases new wells were approved for this purpose.

One of the provisions of the authorizations was that a flow meter must be installed, water use monitored, and the water use records submitted to the department at the end of the irrigation season. At this time, I am writing to request the metering reports on these wells. If you did not drill a well that was authorized, or did not use water that was authorized, please let us know.

My staff will be conducting end of irrigation season field visits in the near future. Your meter records and information on the completion of new wells is greatly appreciated.

If you have questions, please call Suzanne Blakeney at (509) 454-7294.

Sincerely,

Phil Crane, Unit Supervisor
Water Resources Program

SB:PC:gg
011110a



REWRITTEN Aug 22, 2001 JMR

Drought Field Checklist

25 MAY 2001

46° 21' 48.4" N 119° 58' 11.0" W

Date of Field Visit

GPS Reading

64-32973

Certificate / Permit Number

Certificate / Permit Name

RATTRAY

Phone Number

Contact Name

METER (WATER and/or ELECTRICAL) INFORMATION:

YES Type: McCrometer Reading: 036672 ACAB-PART X.001 1.18CF5
Type: Reading:
Type: Reading:

NO Describe alternative measuring technique:

THE NEIGHBOR ON THE SW CORNER OF THE DESCRIBED RATTRAY PROPERTY STATED THROUGH HIS SON TONY BARCENAF (509-334-2521) THAT THEIR DOMESTIC WELL SUCKS AIR WHEN RATTRAY IRR WELL IS PUMPING. THE NEIGHBOR MAY BE IRRIGATING SOME LAND IN ADDITION TO THE DOMEST USE, THIS OVERUSING HIS WELL, PERHAPS ADDITIONAL TESTING SHOULD BE DONE TO SEE IF THERE IS A PROBLEM.

How many users are on the electrical meter:

PUMP INFORMATION: (Should be a tag on the pump)

Type: HP: Head Discharge:

Other pump information:

General Notes: WELL 12" CASING

NO POWER METER VISIBLE

ASPARAGUS CROP BEING IRRIGATED DURING VISIT

APPROXIMATELY 5 ROWS X 24 SPRIKLERAS NELSON.04

4 ROWS X 30 "

Contacts' Questions:

TOM PARKOW

Inspector Name

PHILIP KERR

Inspector Name

UNITED STATES
DEPARTMENT OF THE INTERIOR
GEOLOGICAL SURVEY



20°00'

270°00mE


271

13 MI. TO WASH. 24

57°30'

273

2075 IV
(SULPHUR S)

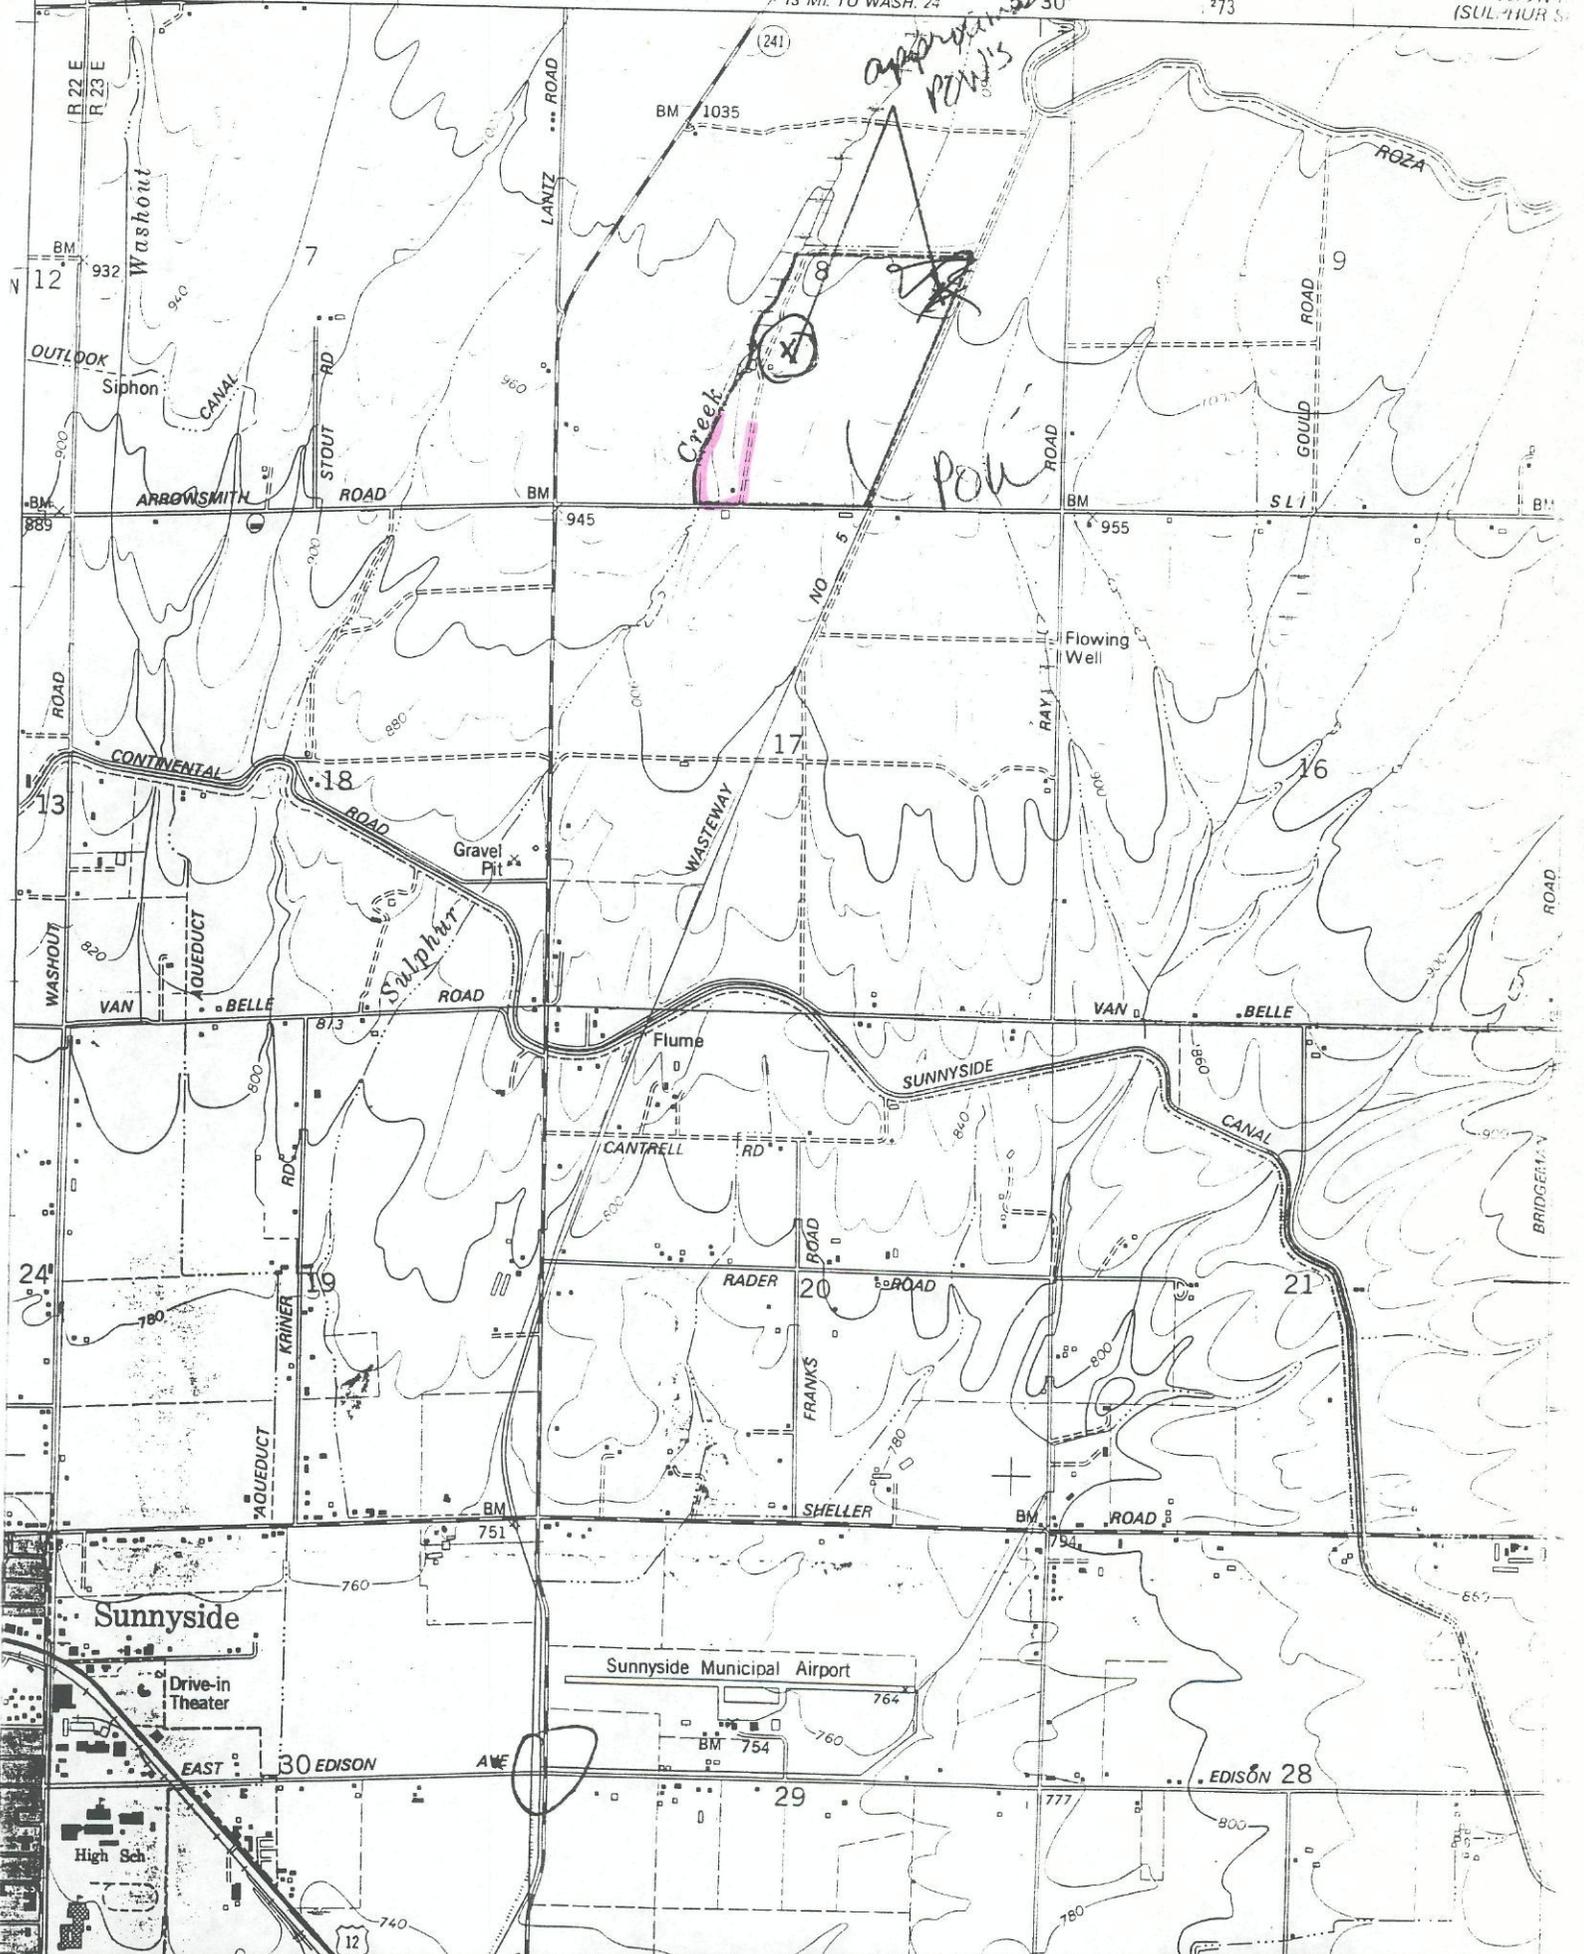

SUNNY SIDE

Drought Field Checklist

23 MAY 01
Date of Field Visit
04-32973
Certificate / Permit Number

46° 21' 48.4" N 119° 58' 11.0" W
GPS Reading
RATTRAY
Certificate / Permit Name

Phone Number

Contact Name

METER (WATER and/or ELECTRICAL) INFORMATION:

YES Type: McCrometer Reading: 036672 Head ~~1.18~~ 1.18 x .001
Type: Reading:
Type: Reading:
NO Describe alternative measuring technique:

NEIGHBOR WELL SUCKING AIR WITH RATTRAY PUMP RUNNING
COSDADO, 6" MAINLINE 90N-TOWY BARCKMAF
509 334 2521 - IMPROV WHAT HAPPENS

How many users are on the electrical meter:

PUMP INFORMATION: (Should be a tag on the pump)

Type: HP: Head Discharge:

Other pump information:

General Notes: WELL 72" CASING
NO POWER METER
ASPARAGUS CROP IRRIGATED DURING VISIT
5 ROWS X ~~30~~ SPINDLES APPROX NELSON .04
4 ROWS X 30

Contacts' Questions:

JOM PERROW
Inspector Name

PAUL W KERRA
Inspector Name

COPY

REWRITTEN August 22, 2001 JMKR

Drought Field Checklist

25 MAY 2001

46° 21' 48.4" N 119° 58' 11.0" W

Date of Field Visit

GPS Reading

G4-32973

Certificate / Permit Number

Certificate / Permit Name

RATTRAY

Phone Number

Contact Name

METER (WATER and/or ELECTRICAL) INFORMATION:

YES Type: MCCROMETER Reading: 036672 ACAB-REPT X.001 1180

Type: Reading:

Type: Reading:

NO Describe alternative measuring technique:

THE NEIGHBOR ON THE SW CORNER OF THE DESCRIBED RATTRAY PROPERTY STATED THROUGH HIS SON TOM BARCEINAF (509-334-2521) THAT THEIR DOMESTIC WELL SUCKS AIR WITHIN RATTRAY IRR WELL IS PUMPING. THE NEIGHBOR MAY BE IRRIGATING SOME LAND IN ADDITION TO THE DOMEST USE, THIS OVERUSING HIS WELL, PERHAPS ADDITIONAL TESTING SHOULD BE DONE TO SEE IF THERE IS A PROBLEM.

How many users are on the electrical meter:

PUMP INFORMATION: (Should be a tag on the pump)

Type: HP: Head Discharge:

Other pump information:

General Notes: WELL 12" CASING

NO POWER METER VISIBLE

ASPARAGUS CROP BEING IRRIGATED DURING VISIT

APPROXIMATELY 5 ROWS X 24 SPARKLEAS NELSON .04

4 ROWS X 30 "

Contacts' Questions:

TOM PARKOW

Inspector Name

PHILIP KERR

Inspector Name

UNITED STATES
DEPARTMENT OF THE INTERIOR
GEOLOGICAL SURVEY



20°00'

1270000mE


1271

13 MI. TO WASH. 24

57°30'

1273

2076 N 11
(SULPHUR S)

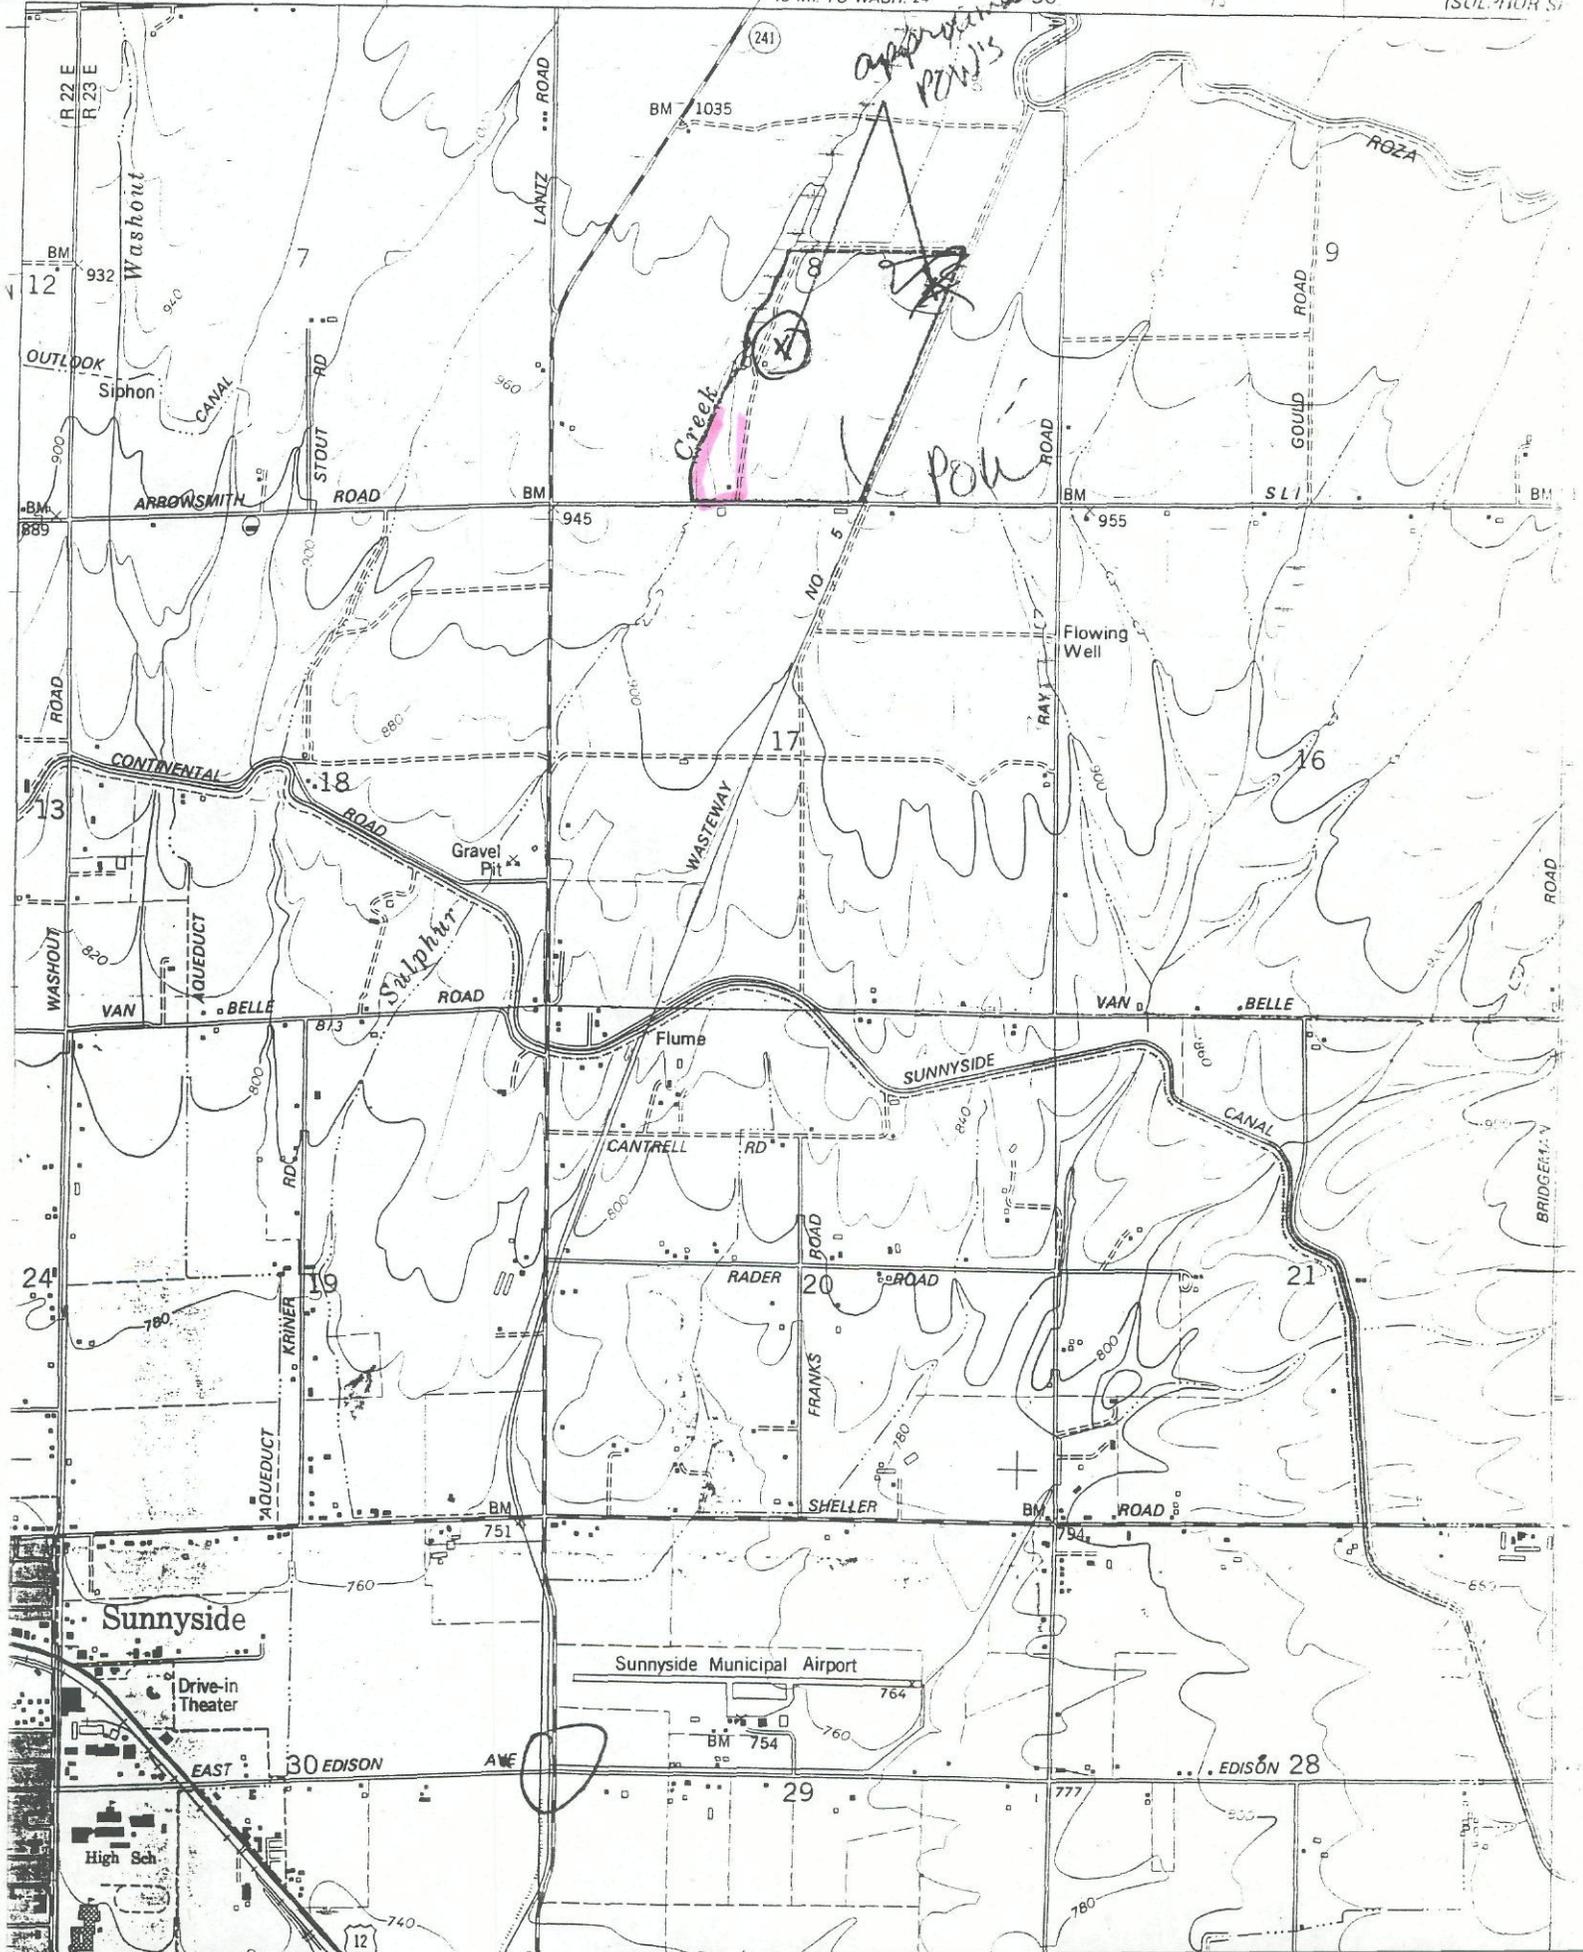

** WATER RIGHTS APPLICATION TRACKING SYSTEM **
 Central Regional Office
 WRATS REPORT BY TRS
 W

CONTROL NUMBER	TYPE/STAT	BUSINESS/PERSON NAME	PRIORITY DATE	WRIA CODE	COUNTY NAME	Q1	ACRE FT/YR	ACRES IRR	DOM UNITS	PURPOSES	SOURCE	TRS	QUAD
G4-110955CL	CL [SI]	CARTER, JOE R		37	YAKIMA					DG IR		T10N/R23E- 8	
G4-34522	AP	CERVANTES ORCHARDS,	7/27/2001	37	YAKIMA	450.000		60		IR.	WELL	T10N/R23E- 8	SE/4NW/4
G4-34522		CERVANTES ORCHARDS,	7/27/2001									T10N/R23E- 8	W/2NE/4
G4-30527AMRIS	AP/REJ	COOK H & T ESTATE,	12/03/90	37	YAKIMA	300.000				ST-DS.	WELL	T10N/R23E- 8	NW/4SE/4
G4-30527AMRIS	CL [SI]	COOK, T. L.		37	YAKIMA					DG ST		T10N/R23E- 8	
G4-30527AMRIS	CL [SI]	COOK, THOMAS L.		37	YAKIMA					DG ST		T10N/R23E- 8	
G4-24974PMRIS	PE/CAN	MARTIN ROBERT J,	3/11/77	37	YAKIMA	1500.000	1300.00	250		IR.	WELL	T10N/R23E- 8	NW/4SE/4
G4-31692	AP	RATRAY, CHARLES	4/08/93	37	YAKIMA	400.000		100		IR-FP.	WELL	T10N/R23E- 8	NE/4SW/4
G4-32973	AP	RATRAY, CHARLES	4/17/2001	37	YAKIMA	400.000		88		IR.	WELL	T10N/R23E- 8	NE/4SW/4
G4-29623ALAMRIS	AP/REJ	SCHUTT BERNIE,	2/23/88	37	YAKIMA	1200.000		112		IR-DS.	WELL	T10N/R23E- 8	N/2NW/4
G4-066002CL	CL [SI]	SIMMONS, WILLARD V.		37	YAKIMA					DG		T10N/R23E- 8	
G4-056626CL	CL [L]	USBR,	0/0/1950	37	YAKIMA					DG	WELL	T10N/R23E- 8	
G4-250611MRIS	PE/CAN	YAMAMOTO GEORGE,	3/25/77	37	YAKIMA	1790.000	641.00	179		IR.	WELL	T10N/R23E- 8	NE/4NW/4
G4-129743CL	CL [SI]	YAMAMOTO, GEORGE K		37	YAKIMA					DG IR		T10N/R23E- 8	

NOTE

This report contains information about water right Certificates, Permits, and Claims. Because of unauthorized changes or non-use, Ecology cannot guarantee the validity of the Permits, and Certificates. Validity of Claims can only be determined in Superior Court. You are encouraged to verify that current use is consistent with the document as described.



STATE OF WASHINGTON

DEPARTMENT OF ECOLOGY

15 West Yakima Avenue, Suite 200 • Yakima, Washington 98902-3452 • (509) 575-2490

June 4, 2001

To: Carroll Palmer, Yakama Nation

RE: Emergency Drought Change Authorizations re:
G4-32982, G4-32983, G4-32973, G4-32978, G4-32961

Enclosed are copies of the Department of Ecology's Emergency Drought Authorization(s), which constitutes our determination and order regarding the above-referenced application(s). If you have any questions or concerns about any of this information, please call Carol Mortensen of the Department of Ecology at (509) 575-2597.

This Order may be appealed pursuant to RCW Chapter 43.21B. The person to whom this Order is issued must file an appeal with the Pollution Control Hearings Board within thirty (30) days of receipt of this Order. Send the appeal to: Pollution Control Hearings Board, P.O. Box 40903, Olympia, Washington 98504-0903. At the same time, a copy of the appeal must be sent to: Department of Ecology, Fiscal Office, P.O. Box 47615, Olympia, Washington 98504-7615. All others receiving notice of this Order must file an appeal with the Pollution Control Hearings Board within thirty (30) days of the date the Order was mailed in the same manner described above.

Sincerely,

Robert F. Barwin, Section Manager
Water Resources Program

RFB:gg
010607a

Enclosures: Emergency Drought Change Authorization(s)

f-10th.doc





STATE OF WASHINGTON

DEPARTMENT OF ECOLOGY

15 West Yakima Avenue, Suite 200 • Yakima, Washington 98902-3452 • (509) 575-2490

May 7, 2001

To: Carroll Palmer, Yakama Nation

RE: **Emergency Drought Permit re: Charles Rattray
(G4-32973)**

Enclosed is a copy of the Department of Ecology's Emergency Drought Permit, which constitutes our determination and order regarding the above-referenced application. If you have any questions or concerns about any of this information, please call Carol Mortensen of the Department of Ecology at (509) 575-2597.

This Order may be appealed pursuant to RCW Chapter 43.21B. The person to whom this Order is issued must file an appeal with the Pollution Control Hearings Board **within thirty (30) days of receipt of this Order**. Send the appeal to: Pollution Control Hearings Board, P.O. Box 40903, Olympia, Washington 98504-0903. At the same time, a copy of the appeal **must be sent to: Department of Ecology, Fiscal Office, P.O. Box 47615, Olympia, Washington 98504-7615**. All others receiving notice of this Order must file an appeal with the Pollution Control Hearings Board **within thirty (30) days of the date the Order was mailed in the same manner described above**.

Sincerely,

Robert F. Barwin, Section Manager
Water Resources Program

RFB:gg
010510a

Enclosures: Emergency Drought Permit

f-1oth.doc

