

State of Washington  
REPORT OF EXAMINATION  
FOR WATER RIGHT APPLICATION

**PRIORITY DATE**  
July 9, 2012

**WATER RIGHT NUMBER**  
G3-30667

**MAILING ADDRESS**  
Stevens County Public Utility District No. 1  
PO Box 592  
Loon Lake, WA 99148-0592

**SITE ADDRESS (IF DIFFERENT)**

**Quantity Authorized for Withdrawal**

WITHDRAWAL RATE	UNITS	ANNUAL QUANTITY	UNITS
30	GPM	0	AF/YR

**Purpose**

PURPOSE	WITHDRAWAL RATE	ANNUAL QUANTITY	PERIOD OF USE (mm/dd)
Municipal	30 GPM	0 AF/YR	01/01 - 12/31

PUBLIC WATER SYSTEM INFORMATION	WATER SYSTEM ID	CONNECTIONS
DOLOMITE	29808T	25

**Source Location**

Source Name	Parcel #	Well Tag	Twp	Rng	Sec	QQ	Latitude	Longitude
Well 2 (S02)	2662386	BPH088	35 N.	40 E.	18	NW¼SW¼	48.53290°N	117.82053°W

Datum: WGS84

**Place of Use (See Attached Map)**

**LEGAL DESCRIPTION OF AUTHORIZED PLACE OF USE**

Area served by Stevens County Public Utility District No. 1. The place of use (POU) of this water right is the service area described in the most recent Stevens County PUD No. 1 Water System Plan approved by the Washington State Department of Health, so long as the water system is and remains in compliance with the criteria in RCW 90.03.386(2). RCW 90.03.386 may have the effect of revising the place of use of this water right.

### Proposed Works

A well, pump, reservoir and distribution system

### Development Schedule

BEGIN PROJECT	COMPLETE PROJECT	PUT WATER TO FULL USE
Begun	September 1, 2015	September 1, 2017

### Measurement of Water Use

How often must water use be measured?	Weekly
How often must water use data be reported to Ecology?	Upon Request by Ecology
What volume should be reported?	Total Annual Volume
What rate should be reported?	Annual Peak Rate of Withdrawal (gpm)

### Provisions

**Total amount authorized from Well S02 under G3-27766C and G3-30667 shall not exceed 95 gallons per minute and 35 acre-feet per year, continuously, for municipal supply.**

This authorization to make use of public waters of the State is subject to existing rights, including any existing rights held by the United States for the benefit of Indians under treaty or otherwise

Nothing in this authorization shall be construed as satisfying other applicable federal, state, or local statutes, ordinances, or regulations.

#### **Wells, Well Logs and Well Construction Standards**

All wells constructed in the state shall meet the construction requirements of WAC 173-160 titled "Minimum Standards for the Construction and Maintenance of Wells" and RCW 18.104 titled "Water Well Construction". Any well which is unusable, abandoned, or whose use has been permanently discontinued, or which is in such disrepair that its continued use is impractical or is an environmental, safety or public health hazard shall be decommissioned.

All wells shall be tagged with a Department of Ecology unique well identification number. If you have an existing well and it does not have a tag, please contact the well-drilling coordinator at the regional Department of Ecology office issuing this decision. This tag shall remain attached to the well. If you are required to submit water measuring reports, reference this tag number.

Installation and maintenance of an access port as described in WAC 173-160- 291(3) is required.

#### **Measurements, Monitoring, Metering and Reporting**

An approved measuring device shall be installed and maintained for each of the sources identified herein in accordance with the rule "Requirements for Measuring and Reporting Water Use", Chapter 173-173 WAC. Water use data shall be recorded weekly and maintained by the property owner for a minimum of five years, and shall be promptly submitted to Ecology upon request.

Recorded water use data shall be submitted via the Internet. To set up an Internet reporting account, contact the Eastern Regional Office. If you do not have Internet access, you can still submit hard copies by contacting the Eastern Regional Office for forms to submit your water use data.

WAC 173-173 describes the requirements for data accuracy, device installation and operation, and information reporting. It also allows a water user to petition the Department of Ecology for modifications to some of the requirements.

### **Department of Health Requirements**

Prior to any new construction or alterations of a public water supply system, the State Board of Health rules require public water supply owners to obtain written approval from the Office of Drinking Water of the Washington State Department of Health. Please contact the Office of Drinking Water prior to beginning (or modifying) your project at DOH/Division of Environmental Health, 16201 E. Indiana Avenue, Suite 1500, Spokane Valley, WA 99216, (509) 329-2100.

### **Water Use Efficiency**

The water right holder is required to maintain efficient water delivery systems and use of up-to-date water conservation practices consistent with RCW 90.03.005.

### **Proof of Appropriation**

The water right holder shall file the notice of Proof of Appropriation of water (under which the certificate of water right is issued) when the permanent distribution system has been constructed and the quantity of water required by the project has been put to full beneficial use. The certificate will reflect the extent of the project perfected within the limitations of the permit. Elements of a proof inspection may include, as appropriate, the source(s), system instantaneous capacity, beneficial use(s), annual quantity, place of use, and satisfaction of provisions.

### **Schedule and Inspections**

Department of Ecology personnel, upon presentation of proper credentials, shall have access at reasonable times, to the project location, and to inspect at reasonable times, records of water use, wells, diversions, measuring devices and associated distribution systems for compliance with water law.

### **Findings of Facts**

Upon reviewing the investigator's report, I find all facts, relevant and material to the subject application, have been thoroughly investigated. Furthermore, I concur with the investigator that water is available from the source in question; that there will be no impairment of existing rights; that the purpose of use is beneficial; and that there will be no detriment to the public interest.

Therefore, I ORDER approval of Application No. G3-30667, subject to existing rights and the provisions specified above.

### **Your Right To Appeal**

You have a right to appeal this Order to the Pollution Control Hearings Board (PCHB) within 30 days of the date of receipt of this Order. The appeal process is governed by Chapter 43.21B RCW and Chapter 371-08 WAC. "Date of receipt" is defined in RCW 43.21B.001(2).

To appeal you must do the following within 30 days of the date of receipt of the Order.

File your appeal and a copy of this Order with the PCHB (see addresses below). Filing means actual receipt by the PCHB during regular business hours.

- Serve a copy of your appeal and this Order on Ecology in paper form - by mail or in person. (See addresses below.) E-mail is not accepted.
- You must also comply with other applicable requirements in Chapter 43.21B RCW and Chapter 371-08 WAC.

Street Addresses	Mailing Addresses
<b>Department of Ecology</b> Attn: Appeals Processing Desk 300 Desmond Drive SE Lacey, WA 98503	<b>Department of Ecology</b> Attn: Appeals Processing Desk PO Box 47608 Olympia, WA 98504-7608
<b>Pollution Control Hearings Board</b> 1111 Israel Road SW Ste 301 Tumwater, WA 98501	<b>Pollution Control Hearings Board</b> PO Box 40903 Olympia, WA 98504-0903

Signed at Spokane, Washington, this xx day of xxx, 2013.

---

Keith L. Stoffel, Section Manager

For additional information visit the Environmental Hearings Office Website: <http://www.eho.wa.gov>. To find laws and agency rules visit the Washington State Legislature Website: <http://www1.leg.wa.gov/CodeReviser>.

#### INVESTIGATOR'S REPORT

Application for Water Right – Stevens County Public Utility District No. 1  
 Water Right Control Number G3-30667

### BACKGROUND

This report serves as the written findings of fact concerning Water Right Application Number G3-30667. Stevens County Public Utility District No. 1 (PUD) submitted an application to increase the instantaneous rate of withdrawal from one existing well for municipal use for the Dolomite Water System near Colville, Washington. The system currently serves 19 connections and is approved for 25 connections. On June 19, 2013, the Washington State Department of Health requested Ecology expedite processing of this application in order to address health and safety concerns for the existing Dolomite Water System.

<b>Applicant Name:</b>	Stevens County Public Utility District No. 1
<b>Date of Application:</b>	July 9, 2012
<b>Place of Use:</b>	Area served by Stevens County Public Utility District No. 1

County	Water Body	Tributary To	WRIA
Stevens	Groundwater	---	59- Colville

Purpose	Rate	Unit	Ac-ft/yr	Begin Season	End Season
Municipal	30	GPM	0	01/01	12/31

Source Name	Parcel #	Well Tag	Twp	Rng	Sec	QQ	Latitude	Longitude
Well 2 (S02)	2662386	BPH088	35 N.	40 E.	18	NW¼SW¼	48.53290°N	117.82053°W

Datum: WGS84

GPM = Gallons Per Minute; Ac-ft/yr = Acre-feet per year; Sec. = Section; QQ Q = Quarter-quarter of a section; WRIA = Water Resource Inventory Area; E.W.M. = East of the Willamette Meridian; Datum: WGS84.

### *Public Notice*

RCW 90.03.280 requires that notice of a water right application be published once a week, for two consecutive weeks, in a newspaper of general circulation in the county or counties where the water is to be stored, diverted and used. Notice of this application was published in the *Statesman-Examiner* on July 24 and 31, 2013.

### *State Environmental Policy Act (SEPA)*

A water right application is subject to a SEPA threshold determination (i.e., an evaluation whether there are likely to be significant adverse environmental impacts) if any one of the following conditions are met.

- (a) It is a surface water right application for more than 1 cubic foot per second, unless that project is for agricultural irrigation, in which case the threshold is increased to 50 cubic feet per second, so long as that irrigation project will not receive public subsidies;
- (b) It is a groundwater right application for more than 2,250 gallons per minute;
- (c) It is an application that, in combination with other water right applications for the same project, collectively exceed the amounts above;
- (d) It is a part of a larger proposal that is subject to SEPA for other reasons (e.g., the need to obtain other permits that are not exempt from SEPA);
- (e) It is part of a series of exempt actions that, together, trigger the need to do a threshold determination, as defined under WAC 197-11-305.

Because this application does not meet any of these conditions, it is categorically exempt from SEPA and a threshold determination is not required.

## **INVESTIGATION**

A field investigation was conducted by Gene Drury on April 23, 2013 and included a meeting at the PUD office with Dick Price (Manager) and Charisse Willis (Special Projects Coordinator). It was noted that the project has started as the PUD has pumped water from the existing well for municipal supply purposes for the Dolomite Water System. This project is located approximately five miles east of Colville, Washington.

The original well (Well S01) was constructed to serve the original Dolomite plat but it did not produce enough water. The well also does not provide adequate quality of water without treatment. Well S01 is a six inch diameter well and 501 feet deep and currently only produces about 6 gallons per minute. This well is authorized under Ground Water Certificate G3-27698C and is only used as an emergency/back-up supply source.

A second well (Well S02) was drilled and added to the system in 1989. Well S02 is authorized under Ground Water Certificate G3-27766 and is the well proposed under this application(G3-30667). Well S02 is a six inch diameter well, drilled 84 feet deep and is the primary water source for the Dolomite system.


The PUD took over operation of the Dolomite water system in February of 2006. The system is serving more than 15 homes making it qualify as a municipal water supply system. A service area map was provided by the PUD. Ground water is pumped to a 20,155 gallon concrete gravity storage reservoir. Both of the wells are currently metered. The PUD is currently pumping about 52 gallons per minute from Well S02. An additional instantaneous amount of 30 gallons per minute is being requested by the PUD from Well S02 under this application to cover the deficiency. A larger pump is proposed to be installed to withdraw the requested additional quantities.

PUD Dolomite System Water Use

- 2012 = 2,028,600 gallons (6.23 acre-feet)
- 2011 = 2,060,700 gallons (6.32 acre-feet)
- 2010 = 2,188,400 gallons (6.72 acre-feet)
- 2009 = 1,945,058 gallons (5.97 acre-feet)
- 2008 = 1,758,260 gallons (5.40 acre-feet)

PUD Dolomite Water System Well Information

Well #	Size	Static Water Level (ft)	Pump Hp.	Well Capacity	Water Right
Well 1 (S01)	6" x 501'	?	1	6 gpm	G3-27698C
Well 2 (S02)	6" x 84'	5-20'	5	52 gpm	G3-27766C

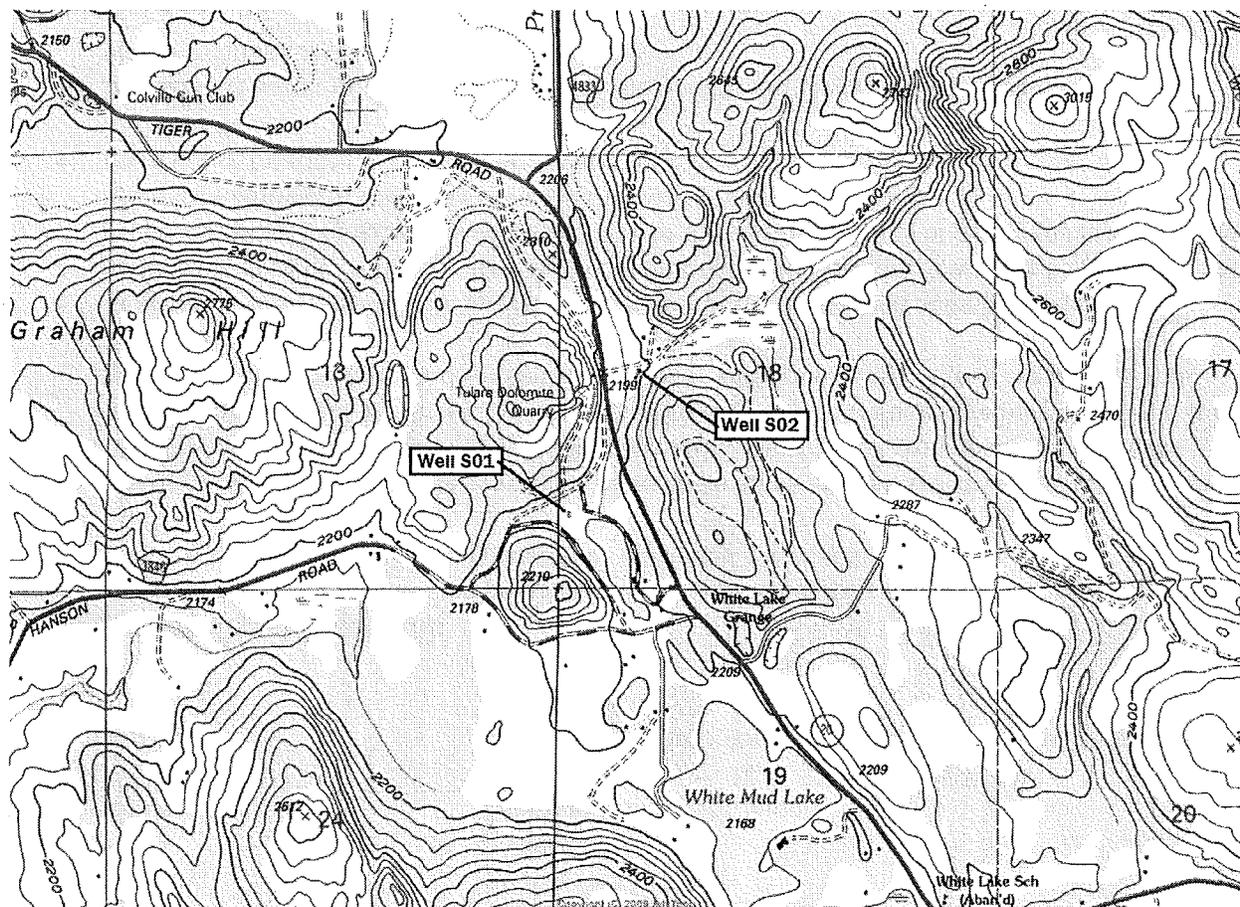

USGS 7.5 Minute (Topographic Map) - "White Mud Lake"

### Proposed Use and Basis of Water Demand

RCW 90.03.386(3) requires a municipal water supplier to apply cost-effective water conservation measures as part of its water system planning. The water supplier must also evaluate the effects of delaying the use of inchoate water rights before it may increase use of those inchoate rights. RCW 90.03.320 requires Ecology to consider the public water supplier's use of conserved water when establishing a surface or ground water right construction schedule.

The applicant has asked for an increase in authorized instantaneous rate of 30 gallons per minute with no increase in annual quantity. The current water system has two operating wells S01 and S02. The two wells are authorized under separate water rights. Well S02 well is capable of more than the authorized 65 gallons per minute. Well S01 is the original well and is used as an emergency backup well. The additional instantaneous amount will provide much needed better quality water from Well S02 and additional fire flow for the existing Dolomite water system. The total authorized amount would be 95 gallons per minute and 35 acre-feet per year.

## Other Rights Appurtenant to the Place of Use

### Ground Water Certificate No. G3-27766C

Recorded Name: Stevens Public Utility District  
Priority Date: January 18, 1984  
Instantaneous Quantity: 65 gallons per minute  
Annual Quantity: 35 acre-feet per year  
Source: A well (S02)  
Purpose of Use: Municipal  
Points of Withdrawal: NW¼SW¼, Sec. 18, T. 35 N., R. 40 E.W.M.  
Place of Use: Area served by Stevens County Public Utility District No. 1. The place of use (POU) of this water right is the service area described in the most recent Stevens County PUD No. 1 Water System Plan approved by the Washington State Department of Health, so long as the water system is and remains in compliance with the criteria in RCW 90.03.386(2). RCW 90.03.386 may have the effect of revising the place of use of this water right.

### Ground Water Certificate No. G3-27698C

Recorded Name: Colville Valley Water Company, Inc.  
Priority Date: November 22, 1983  
Instantaneous Quantity: 45 gallons per minute  
Annual Quantity: 31 acre-feet per year  
Source: A well (S01)  
Purpose of Use: Community Domestic Supply  
Points of Withdrawal: NW¼SW¼SW¼, Sec. 18, T. 35 N., R. 40 E.W.M.  
Place of Use: Are served by the Dolomite Subdivision described as follows:  
(See Certificate)

## Impairment Considerations

Impairment is an adverse impact on the physical availability of water for a beneficial use that is entitled to protection. A water right application may not be approved if it would:

- Interrupt or interfere with the availability of water to an adequately constructed groundwater withdrawal facility of an existing right. An adequately constructed groundwater withdrawal facility is one that (a) is constructed in compliance with well construction requirements and (b) fully penetrates the saturated zone of an aquifer or withdraws water from a reasonable and feasible pumping lift.
- Interrupt or interfere with the availability of water at the authorized point of diversion of a surface water right. A surface water right conditioned with instream flows may be impaired if a proposed use or change would cause the flow of the stream to fall to or below the instream flow more frequently or for a longer duration than was previously the case.
- Interrupt or interfere with the flow of water allocated by rule, water rights, or court decree to instream flows.
- Degrade the water quality of the source to the point that the water is unsuitable for beneficial use by existing users (e.g., via sea water intrusion).

The PUD has requested an increase in instantaneous quantity only, with no additional consumptive water use. Because this requested appropriation is non-additive with respect to annual quantity, and would not result in increased water consumption, this application has no tangible effect on other pending requests and can be processed prior to older pending applications.

The existing well has been in use since 1989 with no reported well interference issues. A review of Ecology records was also conducted for other water rights in the vicinity of the PUD point of withdrawal. The additional instantaneous quantity is available for withdrawal and will not impair existing water rights.

## **Water Availability**

For water to be available for appropriation, it must be both physically and legally available.

### ***Physical availability***

For water to be physically available for appropriation there must be ground or surface water present in quantities and quality and on a sufficiently frequent basis to provide a reasonably reliable source for the requested beneficial use or uses. In addition, the following factors are considered:

- Volume of water represented by senior water rights, including federal or tribal reserved rights or claims;
- Water right claims registered under Chapter 90.14 RCW;
- Ground water uses established in accordance with Chapter 90.44 RCW, including those that are exempt from the requirement to obtain a permit; and
- Potential riparian water rights, including non-diversionary stock water.
- Lack of data indicating water usage can also be a consideration in determining water availability, if the department cannot ascertain the extent to which existing rights are consistently utilized and cannot affirmatively find that water is available for further appropriation.

### ***Legal availability***

To determine whether water is legally available for appropriation, the following factors are considered:

- Regional water management plans – which may specifically close certain water bodies to further appropriation.
- Existing rights – which may already appropriate physically available water.
- Fisheries and other instream uses (e.g., recreation and navigation). Instream needs, including instream and base flows set by regulation. Water is not available for out of stream uses where further reducing the flow level of surface water would be detrimental to existing fishery resources.
- The Department may deny an application for a new appropriation in a drainage where adjudicated rights exceed the average low flow supply, even if the prior rights are not presently being exercised. Water would not become available for appropriation until existing rights are relinquished for non-use by state proceedings.

The PUD has requested an increase in instantaneous quantity only, with no additional consumptive water use. The PUD holds adequate annual acre-feet per year under existing water rights. The increase of 30 gallons per minute from the existing municipal supply system will be for operational purposes only as no additional consumptive water is being withdrawn. The 30 gallons per minute is available for withdrawal.

## **Beneficial Use**

The proposed municipal use of water is defined in statute as a beneficial use (RCW 90.54.020(1)).

## **Public Interest Considerations**

### *Consideration of Protests and Comments*

There has been no public expression of protest or concern regarding the subject proposal, and no findings through this investigation indicate that there would be any detrimental impact to the public welfare through issuance of the proposed appropriation.

## **Conclusions**

It is the conclusion of this examiner that: (1) public groundwater is available for appropriation for an instantaneous withdrawal of 30 gallons per minute, continuously, for municipal supply purposes; (2) this is a beneficial use; (3) it will not impair existing rights; and (4) it will not be detrimental to the public welfare.

## **RECOMMENDATIONS**

Based on the above investigation and conclusions, I recommend that this request for a water right be approved in the amounts and within the limitations listed below and subject to the provisions listed above.

The amount of water recommended is a maximum limit and the water user may only use that amount of water within the specified limit that is reasonable and beneficial:

### **Quantity**

30 gallons per minute; 0 acre-feet per year

Note: This authorization is for an additional 30 gallons per minute for the Dolomite System from Well S02. Ground Water Certificate G3-27766C already authorizes 65 gallons per minute and 35 acre-feet per year from Well S02. Total amount from Well S02 under G3-27766C and this authorization shall not exceed 95 gallons per minute and 35 acre-feet per year, continuously, for municipal supply.

### **Purpose of Use**

Municipal Supply

### **Point of Withdrawal**

Well S02: NW $\frac{1}{4}$ SW $\frac{1}{4}$ , Section 18, Township 35 North, Range 40 E.W.M.

### **Place of Use**

Area served by Stevens County Public Utility District No. 1. The place of use (POU) of this water right is the service area described in the most recent Stevens County PUD No. 1 Water System Plan approved by the Washington State Department of Health, so long as the water system is and remains in compliance with the criteria in RCW 90.03.386(2). RCW 90.03.386 may have the effect of revising the place of use of this water right.